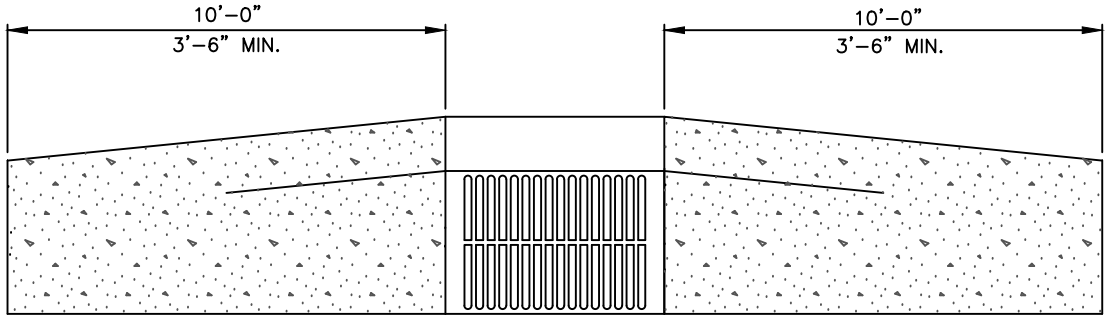

PLAN

NOTE:

1. TRANSITION FROM 2'–6" STANDARD CURB TO VALLEY CURB AT A DRAINAGE INLET ONLY.

2. TRANSITIONS SHORTER THAN 10' SHALL BE APPROVED BY THE CITY ENGINEER. UNDER NO CIRCUMSTANCE SHALL A TRANSITION BE SHORTER THAN 3'–6".

NOT TO SCALE

KANNAPOLIS Engineering

CATCH BASIN FRAME IN VALLEY GUTTER

SEPTEMBER 2022