


ELEVATION VIEW

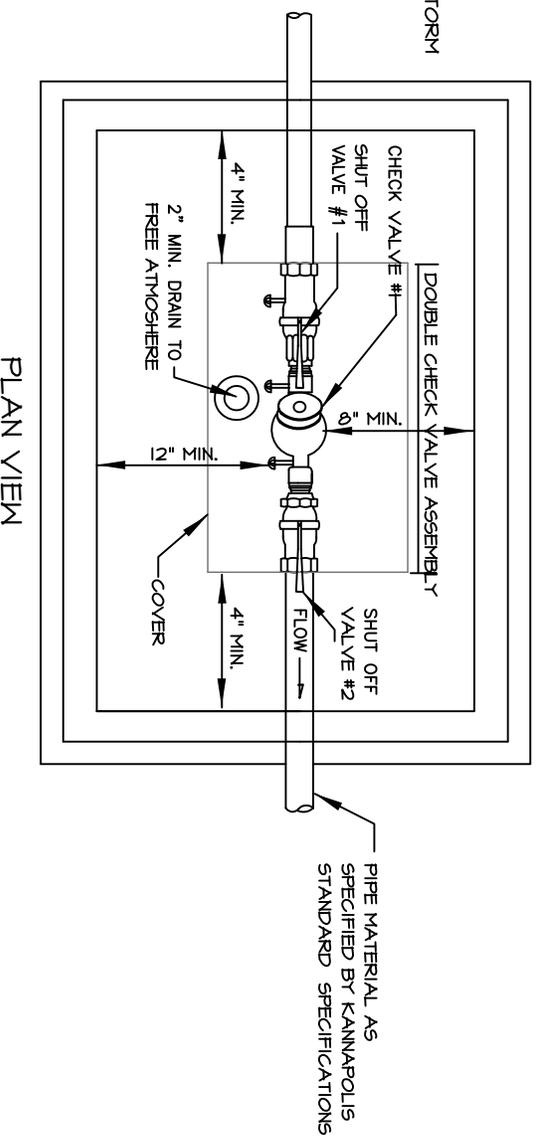

PLAN VIEW

- NOTES:
1. DCVA MUST CONFORM TO CITY OF KANNAPOLIS SPECIFICATIONS FOR BACKFLOW PREVENTION ASSEMBLIES 3/4"-2"
  2. KANNAPOLIS APPROVED DCVAs INCLUDE SHUT OFF VALVE #1 AND VALVE #2 NO SUBSTITUTION SHALL BE PERMITTED.
  3. VAULT, DOORS OR COVERS AND SUPPORT OF ASSEMBLY SHALL BE DESIGNED BY OWNER AND AS REQUIRED.
  4. IF DRAINAGE CANNOT BE PROVIDED TO FREE ATMOSPHERE OR STORM DRAINAGE, THE DCVAs SHALL BE INSTALLED ABOVE GROUND.
  5. TEST COCK #1 SHALL BE UPSTREAM OF SHUT OFF VALVE #1 AND IS PART OF THE APPROVED ASSEMBLY.

**BACKFLOW PREVENTION  
3/4"-2" DOUBLE CHECK VALVE  
ASSEMBLY (DCVA)**



**KANNAPOLIS**  
P U B L I C W O R K S

DATE: 06 JAN 09

W-BF-03