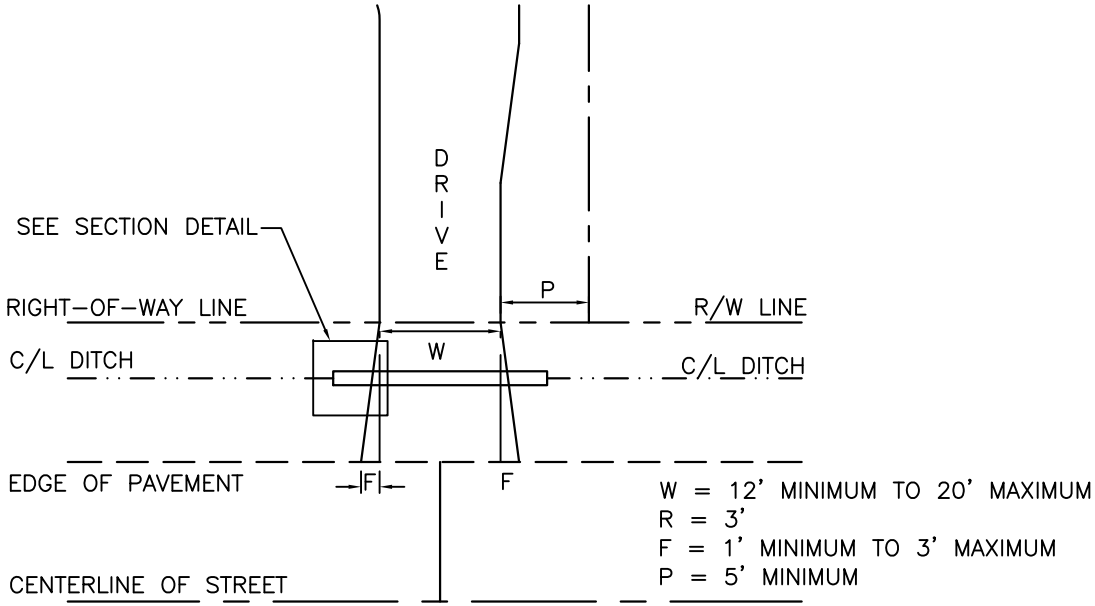

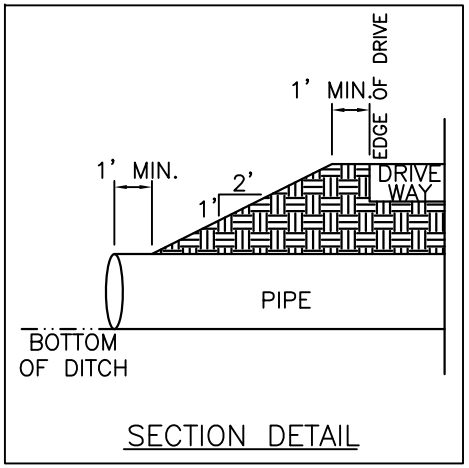

NOTES:

A. THE PIPE SHALL BE A MINIMUM DIAMETER OF 15" REINFORCED CONCRETE OR APPROVED BY KANNAPOLIS AND A MINIMUM LENGTH OF 20'.

B. A LARGER PIPE SIZE MAY BE REQUIRED IF DETERMINED BY A PROFESSIONAL ENGINEER.

C. THE LENGTH OF PIPE REQUIRED SHALL BE THE AMOUNT NEEDED TO EXTEND (1') BEYOND THE TOE OF A 2:1 SLOPE. SEE SECTION DETAIL.

D. NO UTILITIES IN DRIVEWAY, MUST BE MIN. 3' FROM DRIVEWAY

E. DITCH SHOULD BE INSPECTED BY PUBLIC WORKS BEFORE PIPE IS INSTALLED.

KANNAPOLIS
PUBLIC WORKS

SINGLE FAMILY RESIDENTIAL DRIVEWAY WITH NO CURB & GUTTER

DATE: 01 MAY 08

R-DR-03