




**KANNAPOLIS**  
PUBLIC WORKS

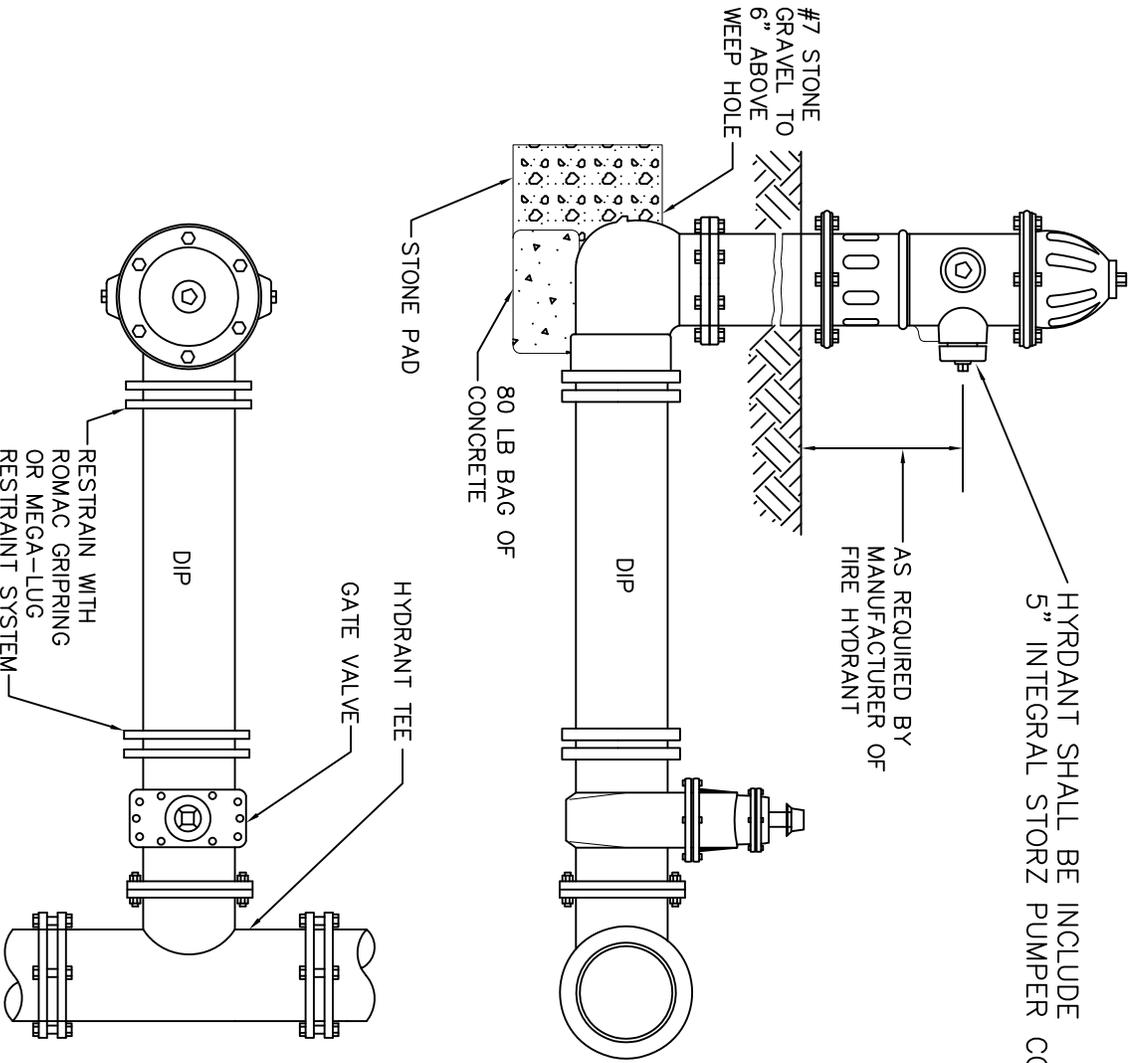

**NOTES:**

HYDRANTS SHALL HAVE 5- $\frac{1}{4}$ " VALVE OPENING AND SHALL CONFORM TO WSACC SPECIFICATIONS

ALL HYDRANTS SHALL BE ONE OF THE FOLLOWING:

- MUELLER - SUPER CENTURION 200
- AMERICAN DARLING - MARK 73-1
- AMERICAN AVK - SERIES 2780

**FIRE HYDRANT**

DATE: 06 JAN 09

W-FH-01