



NOTES:

1. WHERE A TYPE III DRIVEWAY IS APPROVED BY THE KANNAPOLIS ENGINEERING DEPARTMENT THAT CONNECTS TO AN EXISTING SIGNALIZED INTERSECTION, OR AT A LOCATION WHERE A TRAFFIC SIGNAL INSTALLATION IS PROPOSED BASED ON A TRAFFIC IMPACT/SIGNAL WARRANT STUDY, A FULL DEPTH ASPHALT PAVEMENT IS REQUIRED. THIS PAVEMENT DESIGN IS REQUIRED IN THE DRIVEWAY EASEMENT (100-FOOT MINIMUM) TO MAINTAIN DETECTOR LOOPS AND PAVEMENT MARKINGS. A TRAFFIC SIGNAL WILL BE INSTALLED ONLY IF KANNAPOLIS PUBLIC WORKS DETERMINES THAT ONE IS NECESSARY BASED ON A TRAFFIC STUDY OF CURRENT CONDITIONS.
2. MAY BE REQUIRED FOR PUBLIC OR PRIVATE DEVELOPMENTS WITH 200 OR MORE PARKING SPACES.
3. A 4' CONCRETE GUTTER AND WINGS ARE TO BE USED AT THE ENTRANCE TO PROVIDE PROPER DRAINAGE, EXCEPT AT EXISTING OR PROPOSED TRAFFIC SIGNAL LOCATIONS, OR AT LOCATIONS WHERE THE CROSS SLOPE OF THE DRIVEWAY EXCEEDS 2%. SEE SECTION A-A FOR DETAIL.
4. THE DRIVEWAY MUST RISE 6" FROM THE GUTTER LINE TO PREVENT RUNOFF FROM ENTERING DRIVEWAY. ALL DRIVEWAYS MUST MEET THE CURRENT CITY DRIVEWAY REGULATIONS AND NCDOT REQUIREMENTS FOR SPACING, SIGHT DISTANCE, AND OFFSETS FROM PROPERTY LINES AND INTERSECTIONS.
5. TWO (2) CURB RAMP PER CURB RETURN REQUIRED AT SIGNALIZED INTERSECTIONS.
6. MAINTAIN UP TO 1.5% (MAX. 2%) CROSS-SLOPE ON THE PEDESTRIAN ACCESS ROUTE BETWEEN CURB RAMP. CONCRETE IS OPTIONAL FOR THE CROSSWALK AREA IN THE DRIVEWAY.
7. RADIUS REQUIREMENTS: SEE TABLE A-1 IN CHAPTER 2 OF THE KANNAPOLIS LDSM.
8. ALL CONCRETE TO BE MINIMUM NCDOT CLASS B, 6" MIN. THICKNESS.
9. ALL DRIVEWAYS MUST MEET THE CURRENT CITY DRIVEWAY REGULATIONS AND NCDOT REQUIREMENTS FOR SPACING, SIGHT DISTANCE AND OFFSETS FROM PROPERTY LINES AND INTERSECTIONS.
10. ALL CURB OR CURB AND GUTTER AND SIDEWALKS ARE TO BE REMOVED TO THE NEAREST JOINT BEYOND NEW CONSTRUCTION OR CUT WITH A SAW AND REMOVED. SAW CUT OR JOINT TO BE PERPENDICULAR TO EDGE OF EXISTING PAVEMENT.
11. FOR PLANTING STRIP LESS THAN 6', SLOPE SIDEWALK TO MEET GRADE OF ENTRANCE. SIDEWALK GRADE SHALL BE 12:1 MAX.
12. NO UTILITIES PERMITTED IN DRIVEWAYS.
13. NO DRIVEWAY SHALL BE WITHIN 5' (AS MEASURED ALONG STREET CURB STARTING AT THE DRIVEWAY RADIUS) OF ANY MUNICIPAL OR STATE OWNED FEATURE (I.E. CURB INLETS, FIRE HYDRANTS, UTILITY POLES OR SIMILAR STRUCTURES).

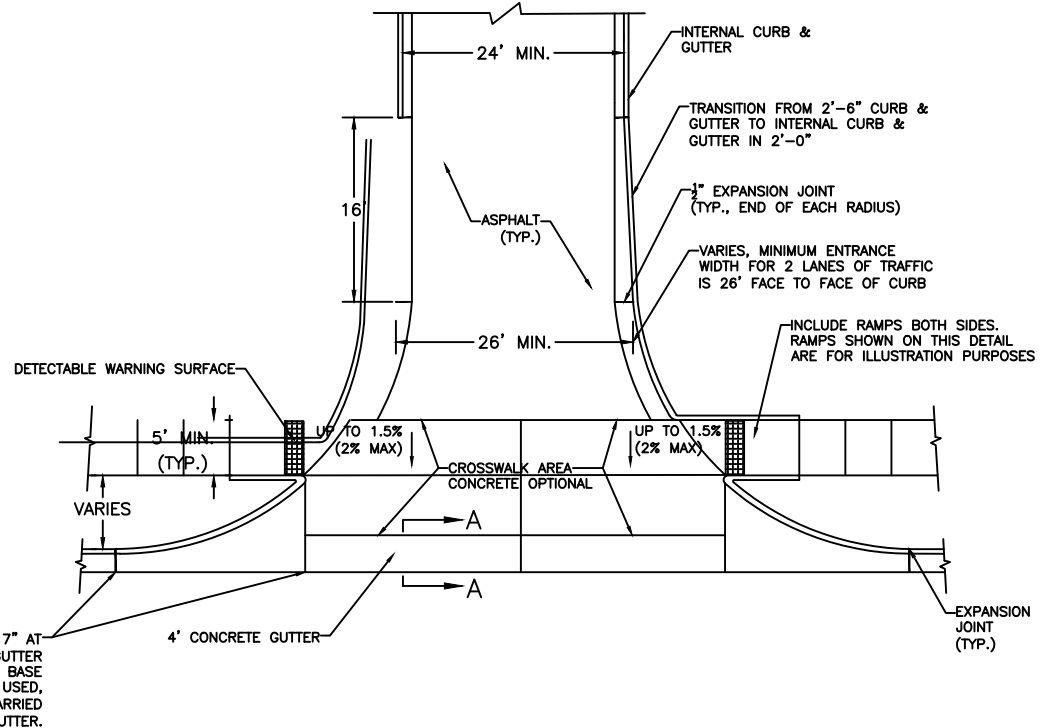

SECTION A-A

* TRANSITION CONCRETE DEPTH FROM 7" AT LIP TO 10" AT 4' CONCRETE GUTTER CONSTRUCTION JOINT IF NO ASPHALT BASE INSTALLED. IF ASPHALT BASE IS USED, 7" CONCRETE DEPTH CAN BE CARRIED THROUGH THE 4' CONCRETE GUTTER.

NOT TO SCALE

TYPE III DRIVEWAY ENTRANCE

