
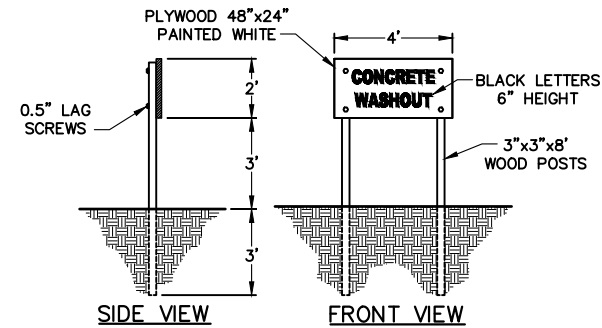
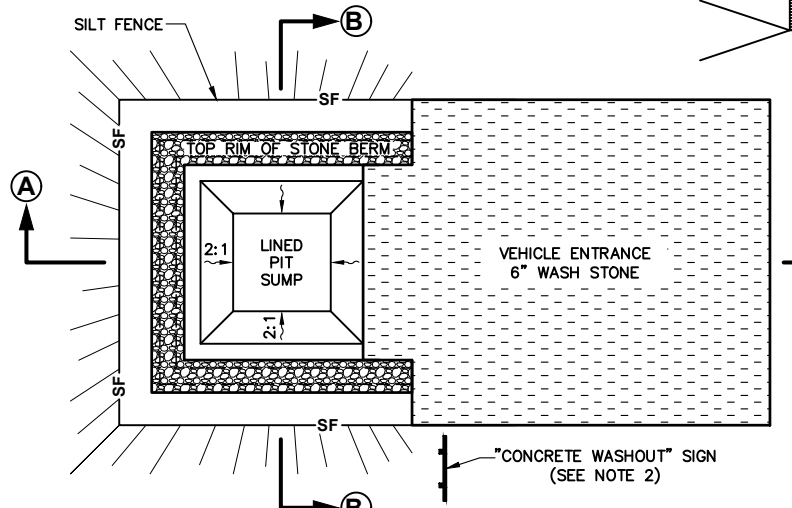
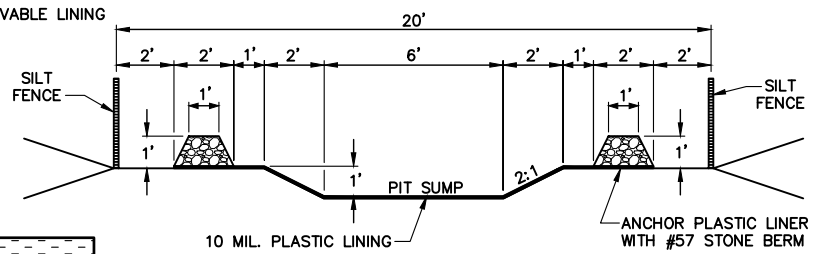


NOTES:

1. ACTUAL LOCATION DETERMINED IN FIELD.
2. THE CONCRETE WASHOUT FACILITY SHALL BE MAINTAINED WHEN THE LIQUID AND/OR SOLID REACHES 75% OF THE STRUCTURES CAPACITY.
3. CONCRETE WASHOUT FACILITY SHALL BE CLEARLY MARKED WITH SIGN INSTALLED WITHIN 30 FEET OF THE CONCRETE WASHOUT FACILITY.

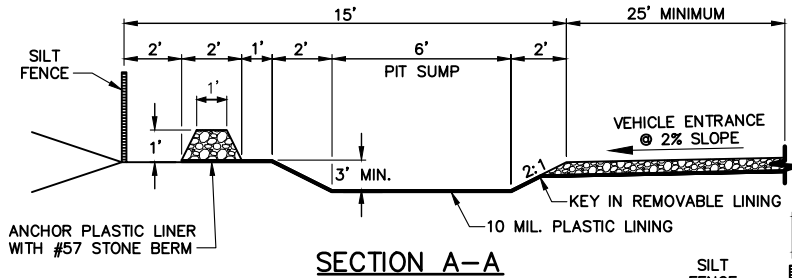

NOT TO SCALE

CONCRETE WASHOUT PIT

