


NOTES:
 HYDRANTS SHALL HAVE 5-¹/₄" VALVE OPENING AND SHALL CONFORM TO WSACC SPECIFICATIONS



NOT TO SCALE

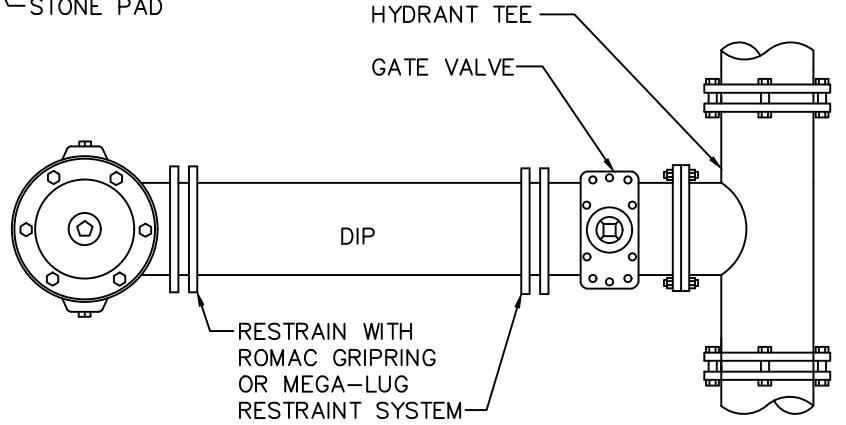

FIRE HYDRANT